




STEP #1

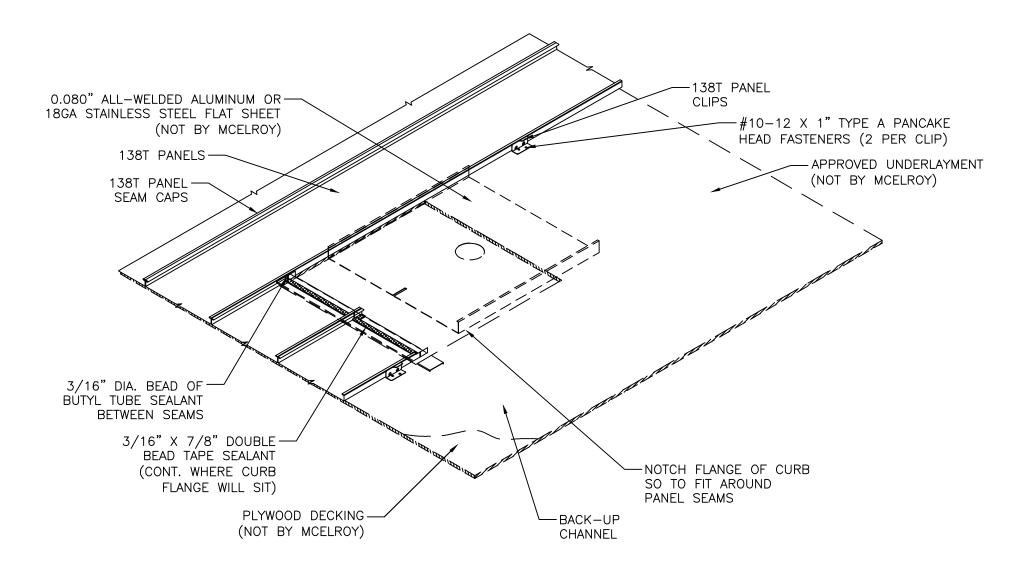

STEP #2

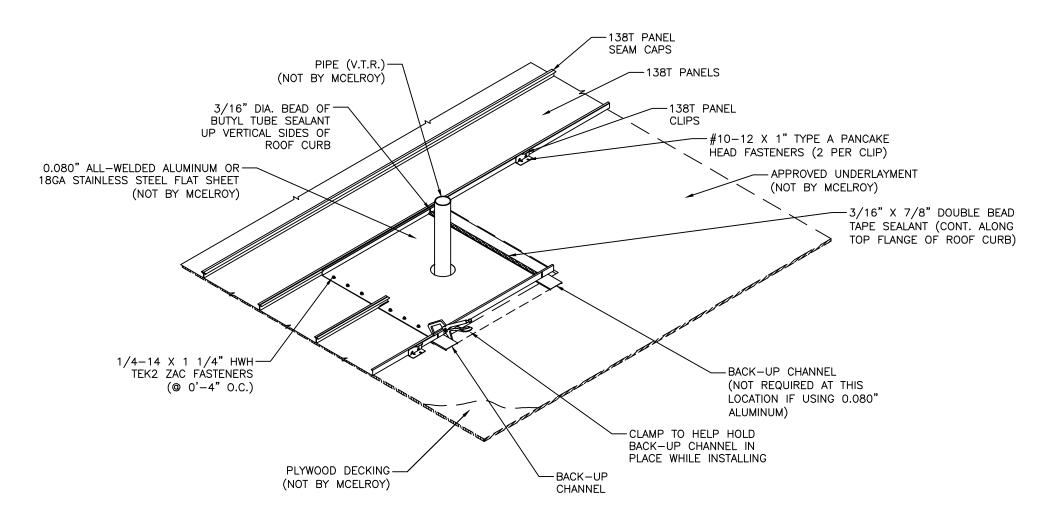

STEP #3

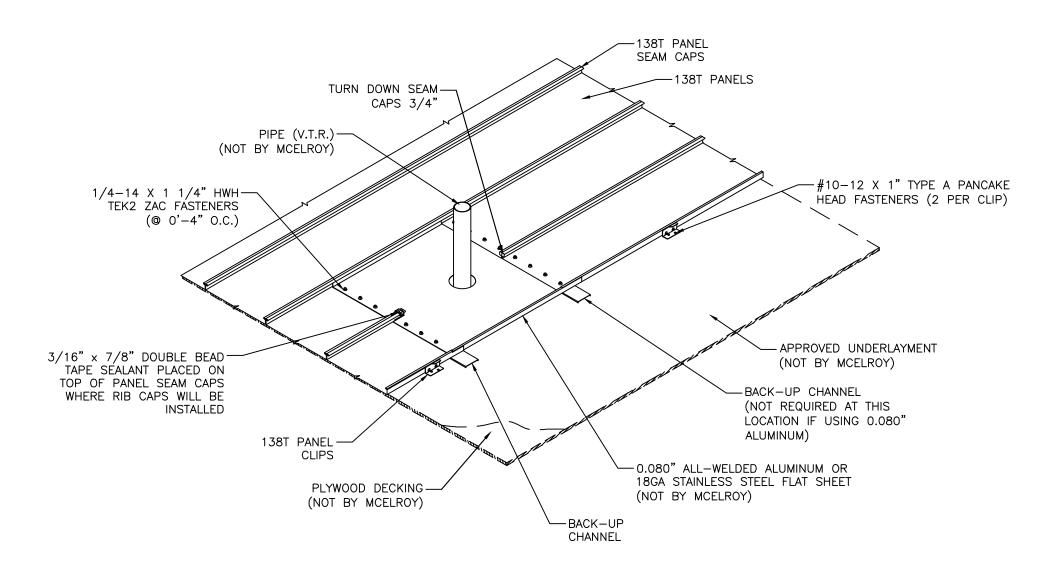

STEP#4

DAMAGE FROM SLIDING ICE AND SNOW. PIPE (V.T.R.)-(NOT BY MCELROY) STAINLESS STEEL DRAWBAND -138T PANELS (RECOMMENDED) 138T PANEL (NOT BY MCELROY) SEAM CAPS DEKTITE PIPE BOOT -(NOT BY MCELROY) APPROVED UNDERLAYMENT 1/4-14 X 7/8" LAPTEK ZAC-(NOT BY MCELROY) FASTÉNERS (@ 0'-2" O.C. MAX.) 3/16" DIA. BEAD OF BUTYL TUBE SEALANT (CONT. AROUND SCREW FLANGE OF PIPE BOOT) 1/4-14 X 1 1/4" HWH TEK2 ZAC FÁSTENERS (@ 0'-4" O.C.) 0.080" ALL-WELDED ALUMINUM OR 0.080" ALL-WELDED ALUMINUM OR 18GA STAINLESS STEEL FLAT SHEET 18GA STAINLESS STEEL RIB CAPS (NOT BY MCELROY) (NOT BY MCELROY) FILL CAPS WITH 1" DEPTH OF BUTYL TUBE SEALANT AND SET OVER SEAMS. THEN FILL CAVITY WITH BACKER-ROD. SECURE BACKER-ROB IN PLACE BY PLYWOOD DECKING FILLING LAST BIT OF CAP WITH COLOR

MATCHED TITE-BOND SEALANT

NOTE: GUTTERS AND PENETRATIONS SHOULD BE PROTECTED BY A SNOWGUARD SYSTEM TO PREVENT

STEP #5

(NOT BY MCELROY)