




DETAIL "A"

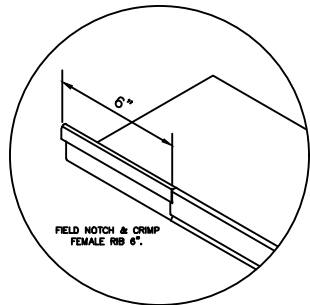


DETAIL "B"

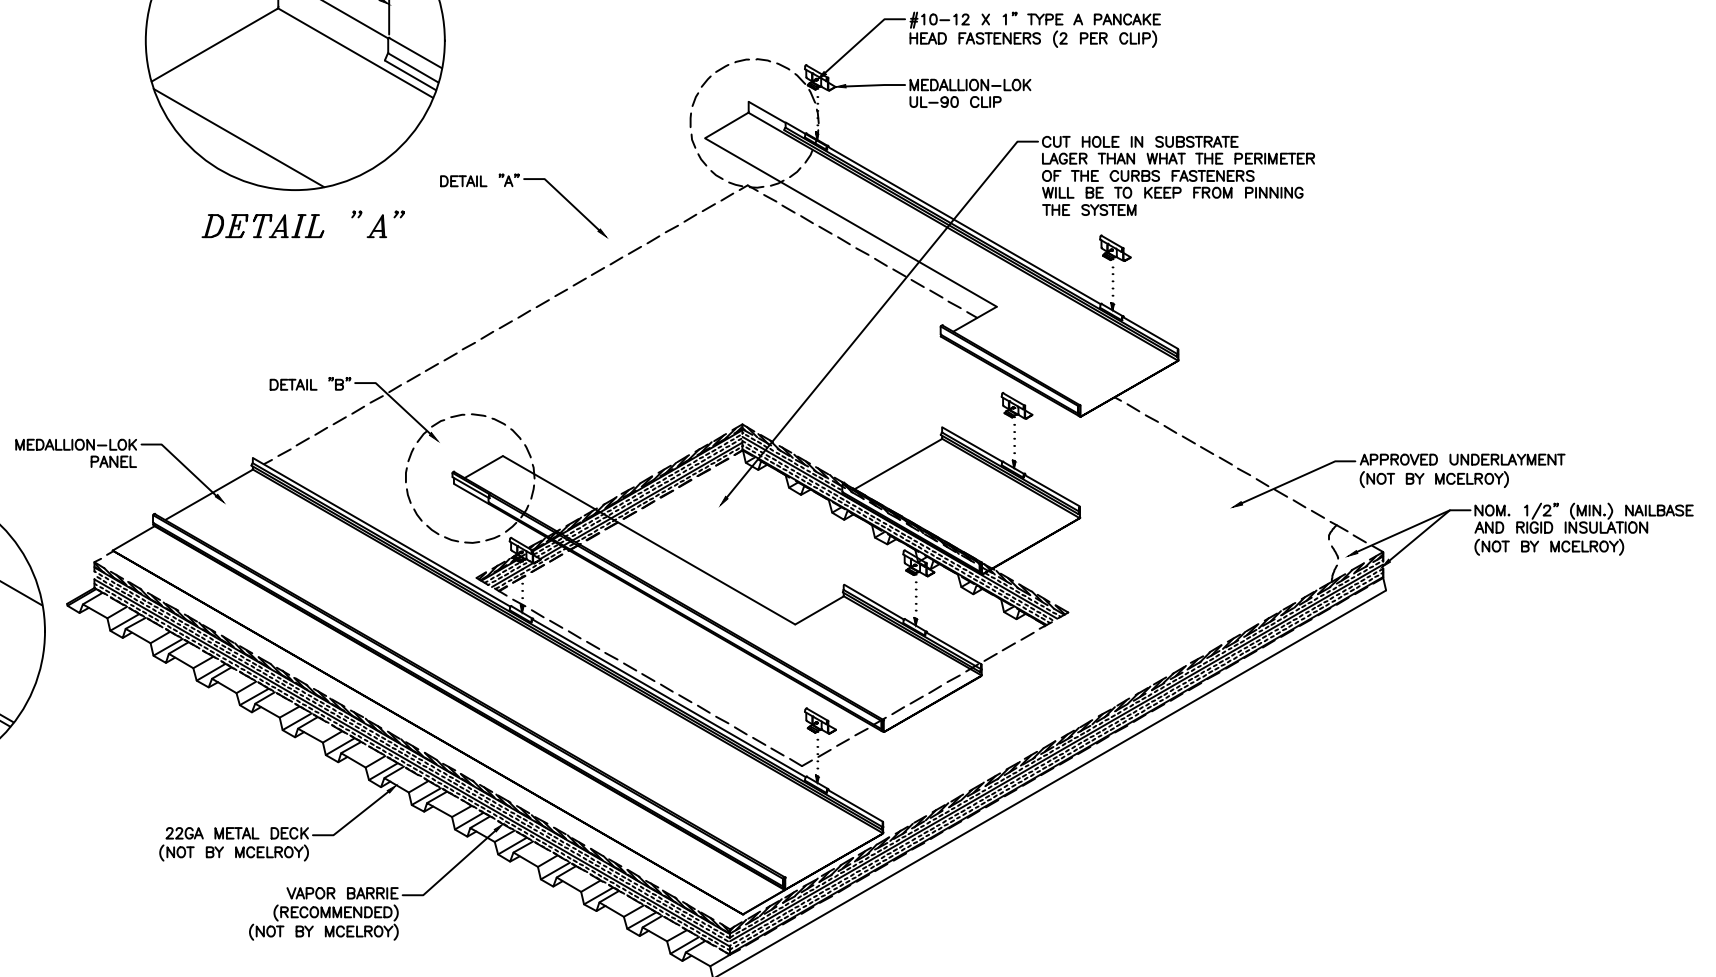


STEP 1

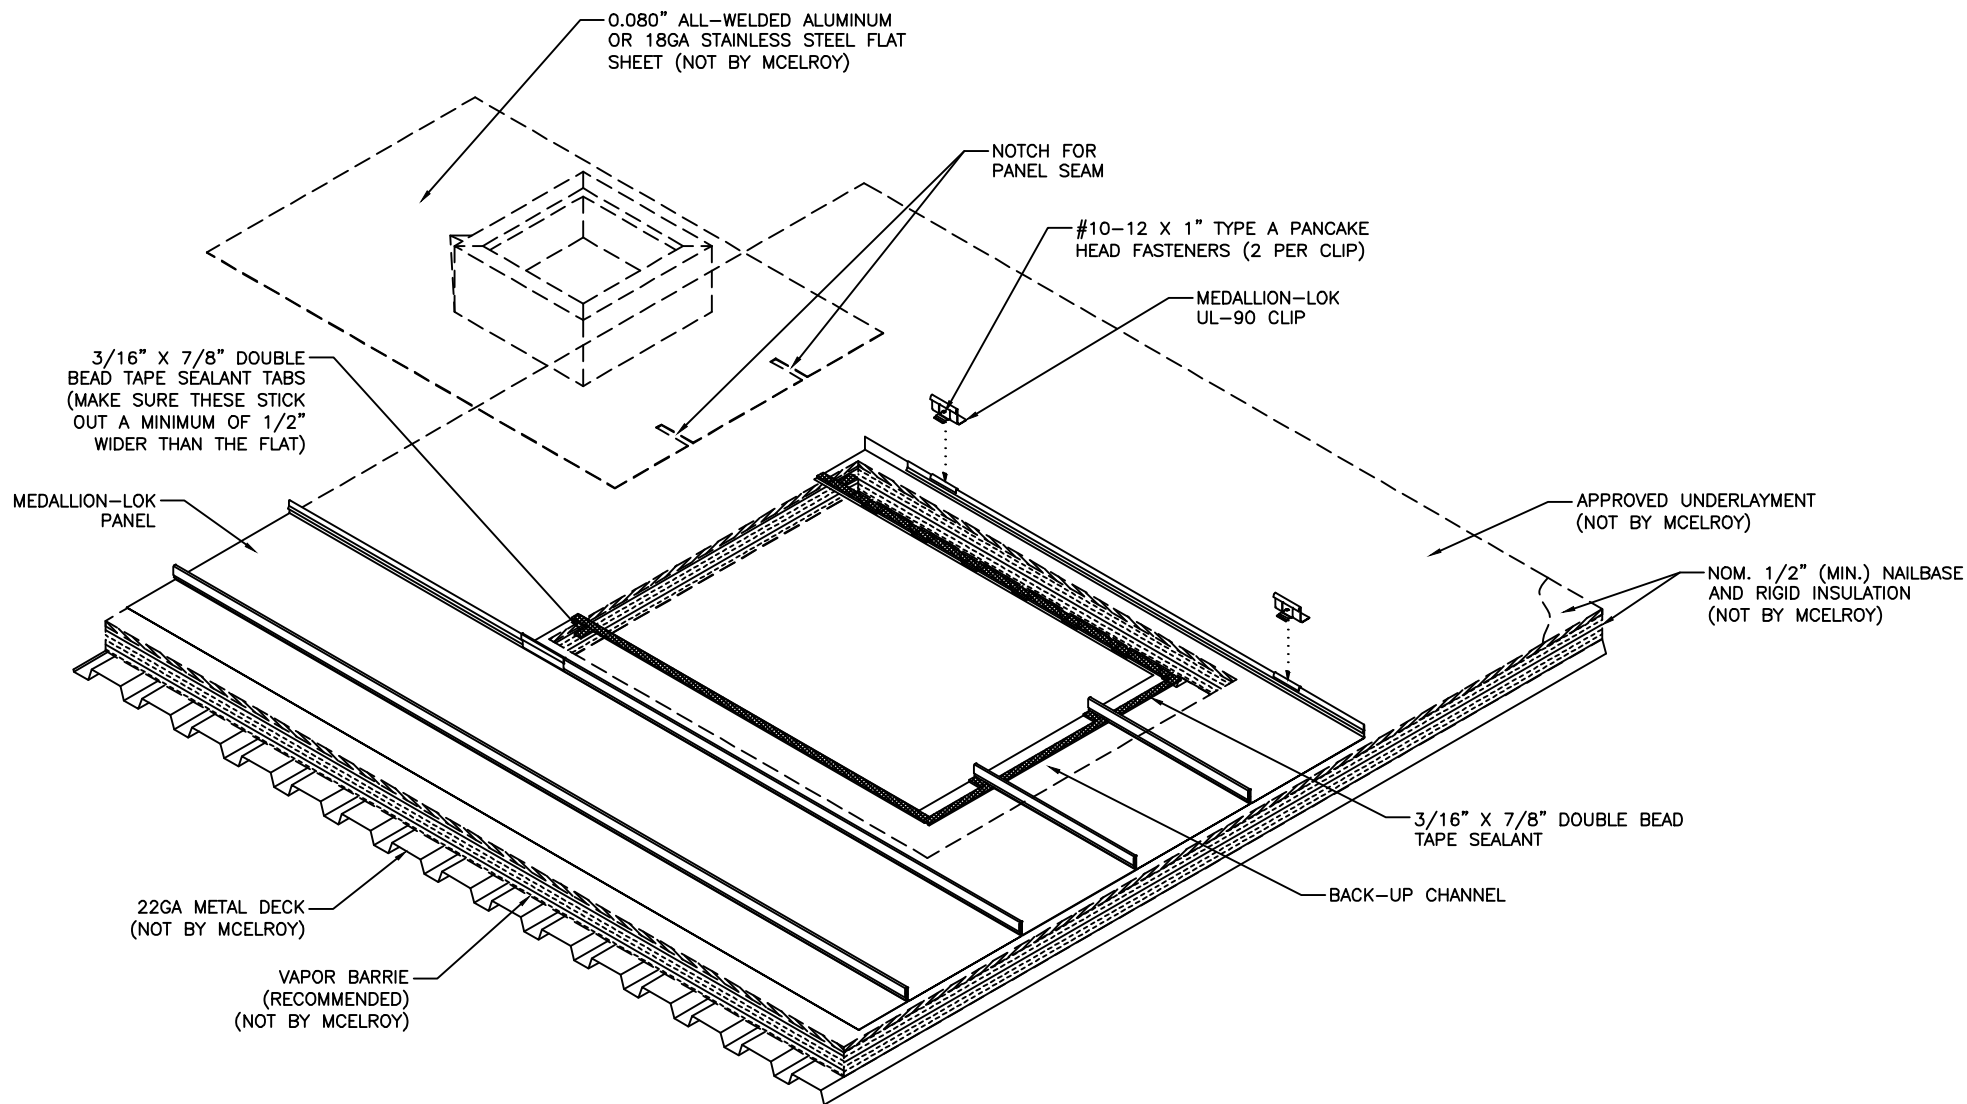

STEP 2

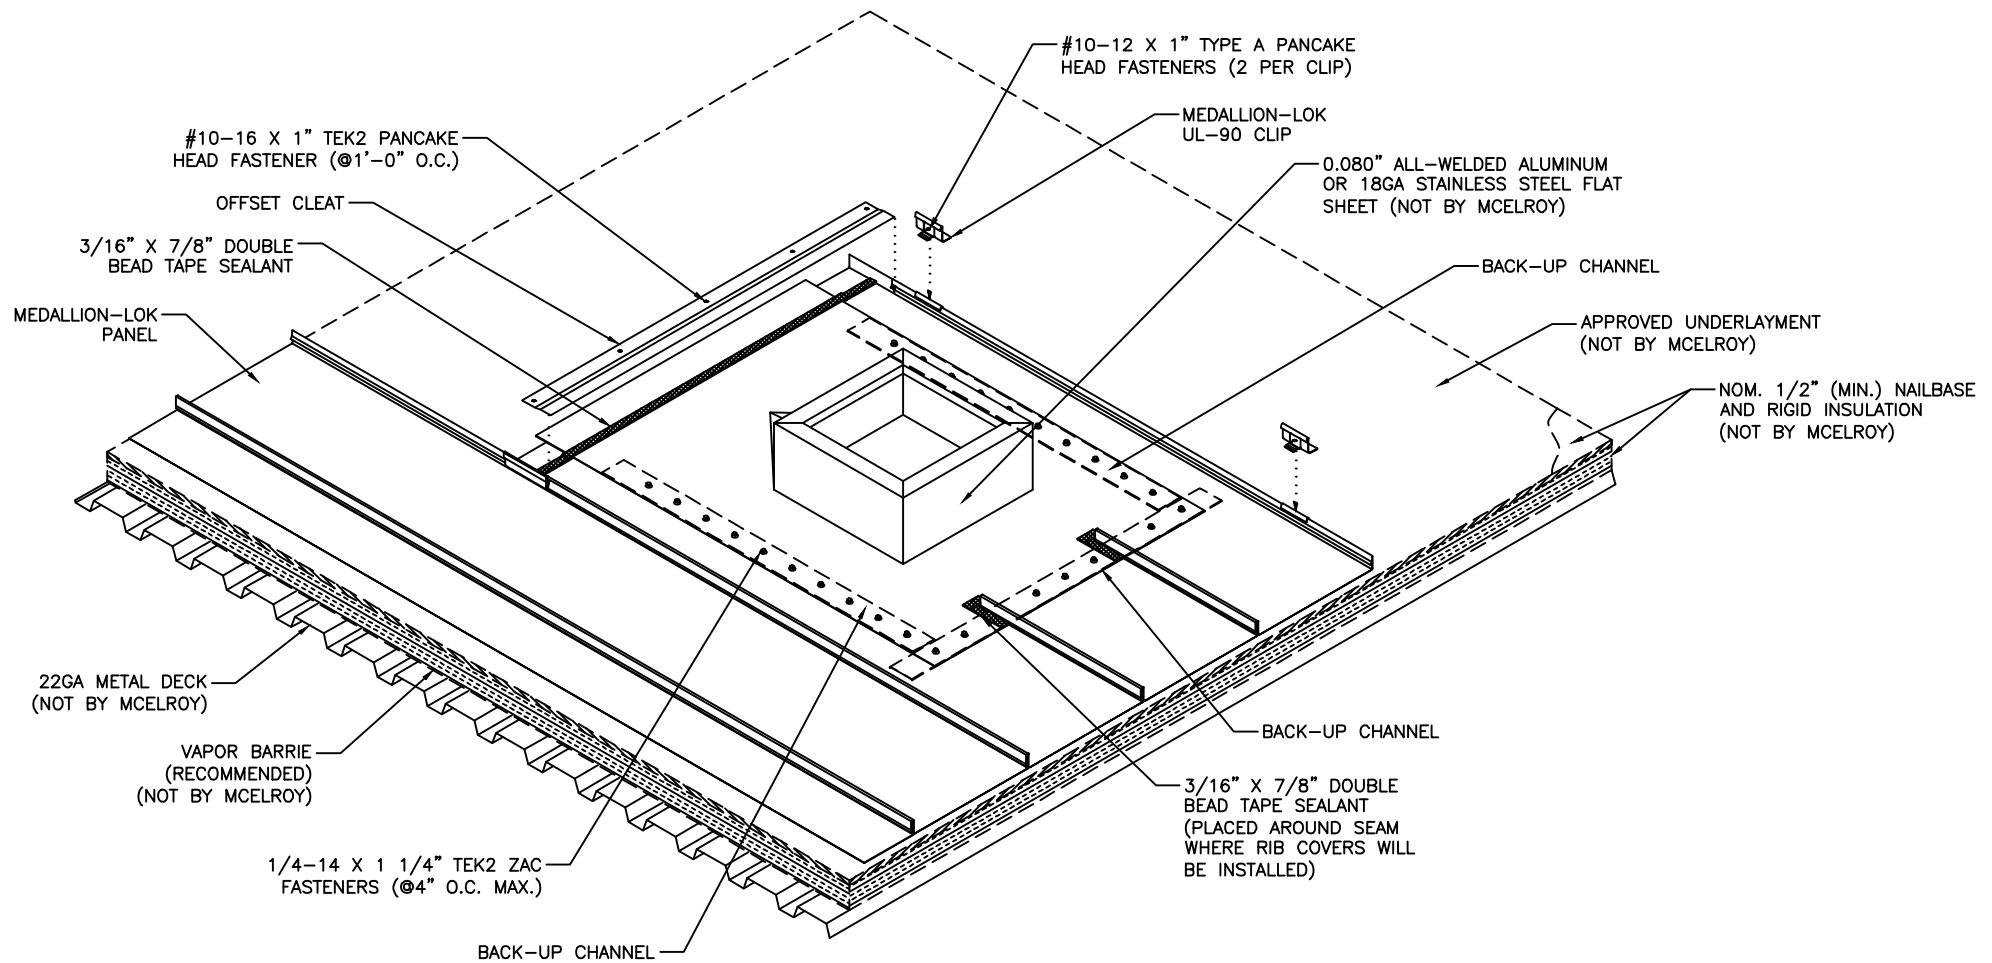


STEP 3

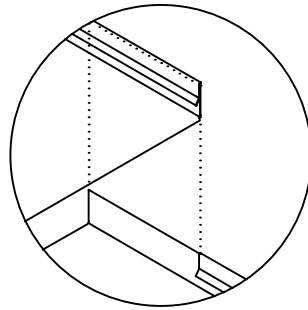

DETAIL "C"

DETAIL "C"

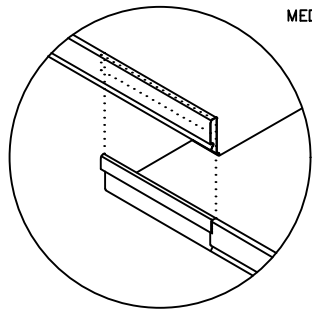

DETAIL "D"

MEDALLION-LOK
PANEL

DETAIL "D"

22GA METAL DECK
(NOT BY MCELROY)

VAPOR BARRIER
(RECOMMENDED)
(NOT BY MCELROY)

1/4-14 X 1 1/4" TEK2 ZAC
FASTENERS (Ø4" O.C. MAX.)

0.080" ALL-WELDED ALUMINUM
OR 18GA STAINLESS STEEL ROOF
CURB (NOT BY MCELROY)

"E"

#10-16 X 1" TEK2 PANCAKE
HEAD FASTENERS (2 PER CLIP)

MEDALLION-LOK
UL-90 CLIP


APPROVED UNDERLAYMENT
(NOT BY MCELROY)

NOM. 1/2" (MIN.) NAILBASE
AND RIGID INSULATION
(NOT BY MCELROY)

0.080" ALL-WELDED ALUMINUM
OR 18GA STAINLESS STEEL RIB
COVER (NOT BY MCELROY)
(FILL 2/3 FULL OF BUTYL TUBE
SEALANT BEFORE INSTALLING)

1/4-14 X 1 1/4" TEK2 ZAC
FASTENERS (Ø2" O.C. MAX.)

STEP 4

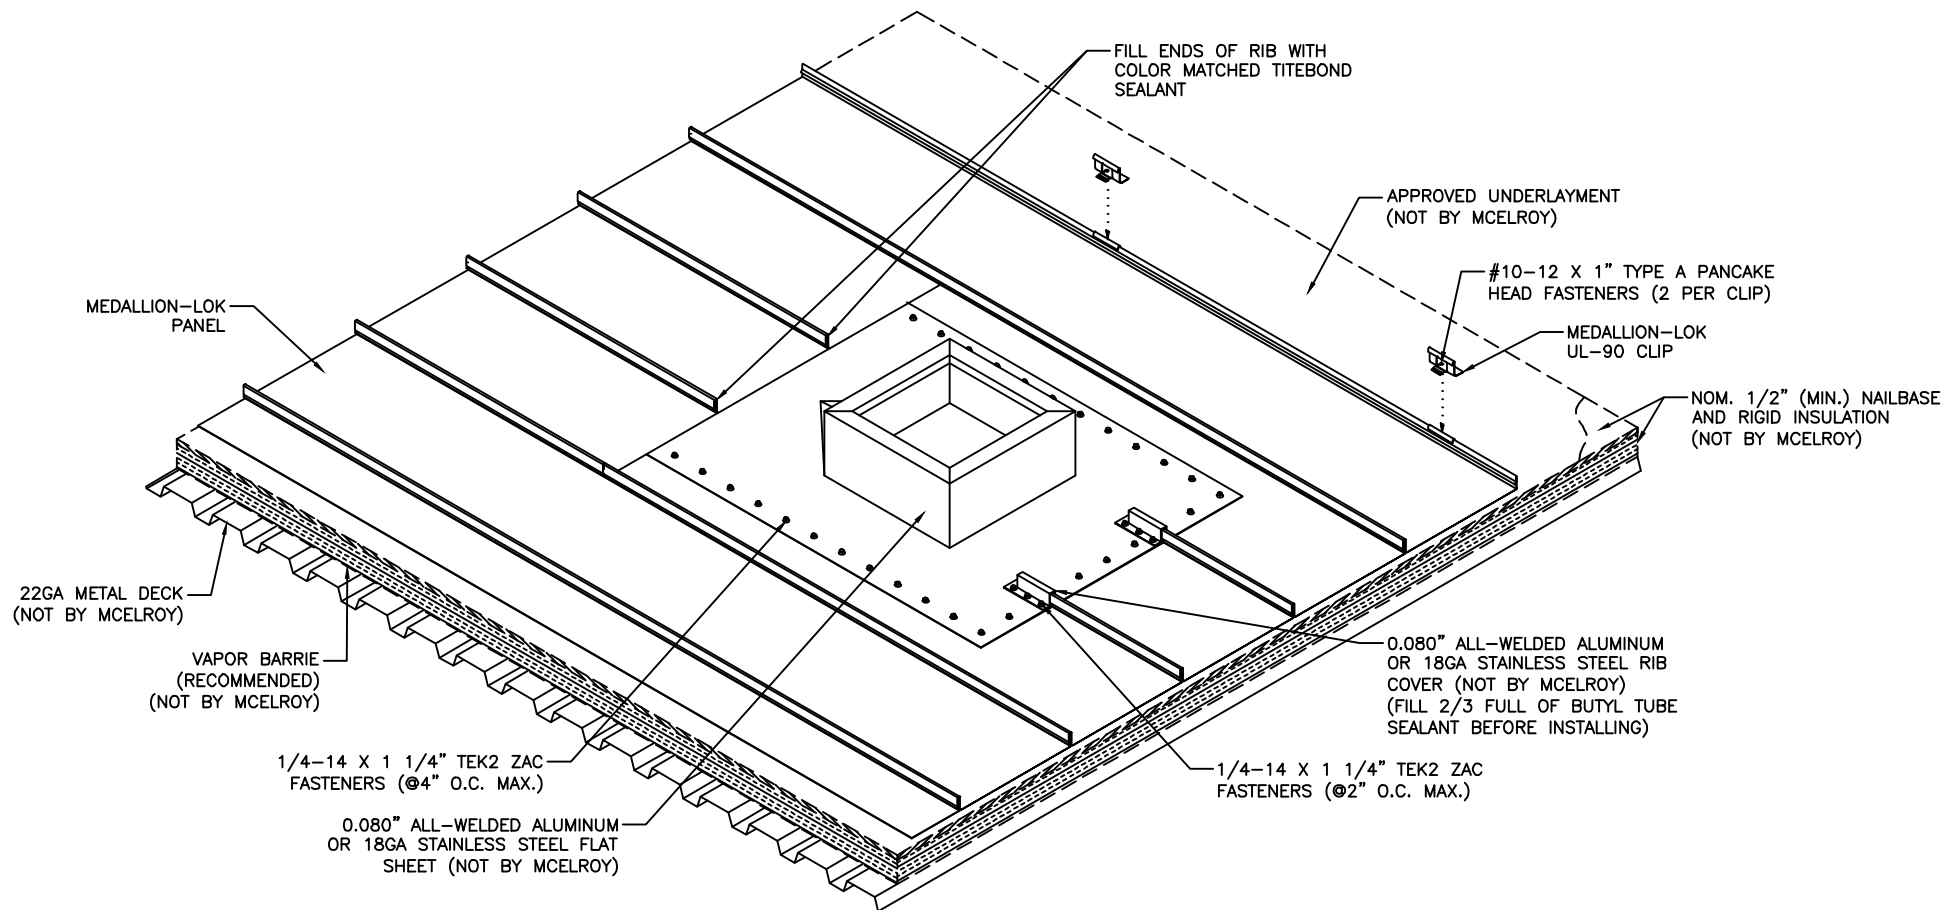

STEP 5

