




STEP #1

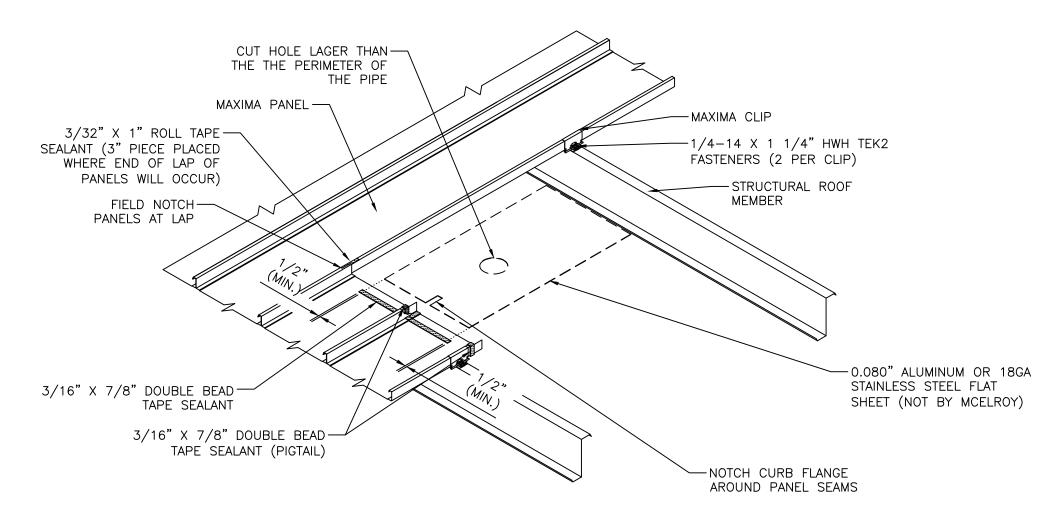

STEP #2

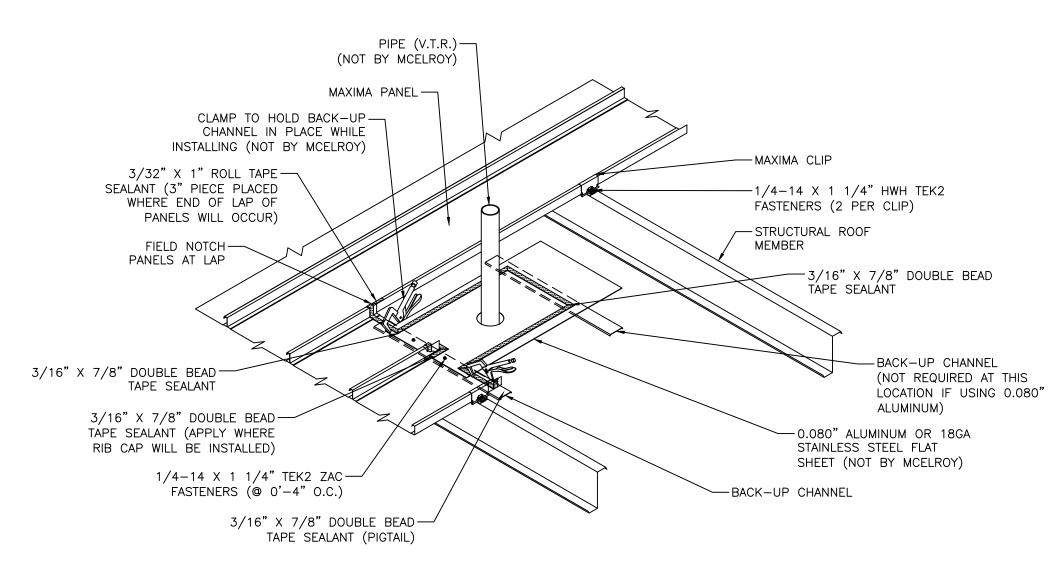

STEP #3

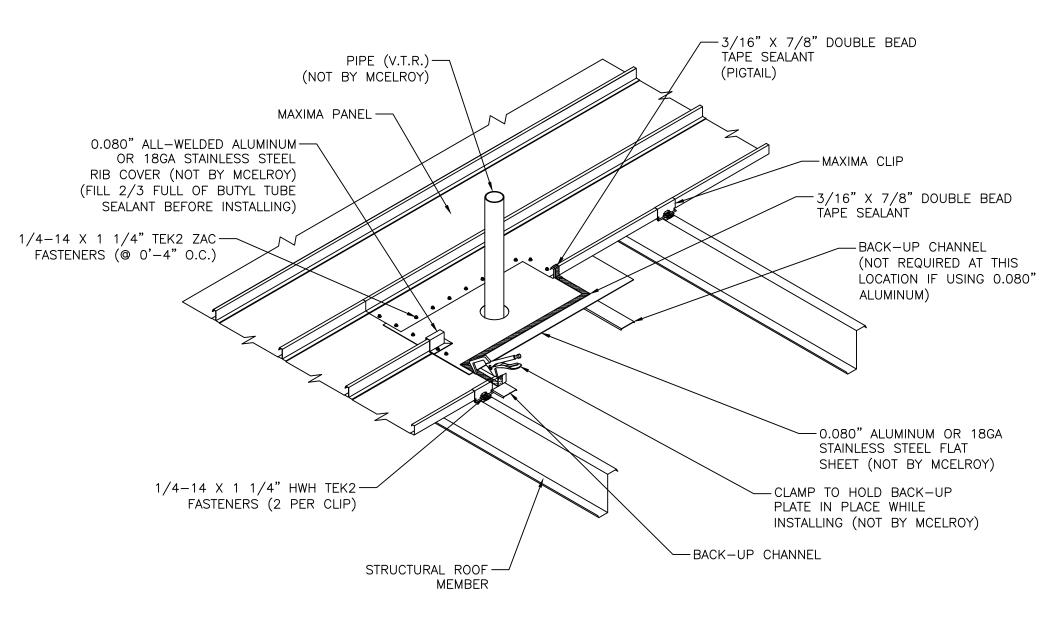

STEP #4

NOTE: GUTTERS AND PENETRATIONS SHOULD BE PROTECTED BY A SNOWGUARD SYSTEM TO PREVENT DAMAGE FROM SLIDING ICE AND SNOW. MAXIMA PANEL PIPE (V.T.R.) (NOT BY MCELROY) STAINLESS STEEL DRAWBAND-(RECOMMENDED) (NOT BY MCELROY) DEKTITE PIPE BOOT -(NOT BY MCELROY) 1/4-14 X 7/8" LAPTEK ZAC FASTENERS (@ 0'-2" O.C. MAX.) 0.080" ALL-WELDED ALUMINUM OR 18GA STAINLESS STEEL RIB COVER (NOT BY MCELROY) (FILL 2/3 FULL OF BUTYL TUBE SEALANT BEFORE INSTALLING) 0.080" ALUMINUM OR 18GA STAINLESS STEEL FLAT 1/4-14 X 1 1/4" TEK2 ZAC SHEET (NOT BY MCELROY) FASTENERS (@ 0'-4" O.C.) 3/16" DIA. BEAD STRUCTURAL ROOF OF BUTYL TUBE SEALANT **MEMBER** (CONT. AROUND SCREW FLANGE OF PIPE BOOT)